



Environmental Monitoring Report

PUBLIC

Semestral Report: November 2023 – April 2024
July 2024

India: West Bengal Drinking Water Sector Improvement Project

Part 3 of 3: Appendix 5 (continued) and Appendices 6 - 8

Prepared by Public Health Engineering Department, Government of West Bengal for the Asian Development Bank (ADB).

This environmental monitoring report is a document of the borrower. The views expressed herein do not necessarily represent those of ADB's Board of Directors, Management, or staff, and may be preliminary in nature. Your attention is directed to the "terms of use" section of ADB's website.

In preparing any country program or strategy, financing any project, or by making any designation of or reference to a particular territory or geographic area in this document, ADB does not intend to make any judgments as to the legal or other status of any territory or area.

Asian Development Bank

Annexure to NOC Sl. NO164647

Special Conditions issued to **Water Treatment Plant -117 MLD** by WBDWSIP , PHE Directorate, Govt. of **Wset Bengal** located at Mouza-Jalpai & Sitalpur, JI No.70 & 71 under Sitalpur Gram Panchayat of Nandakumar Block, Dist-East Medinipur.

A. Emission:- Nil


B. Raw Water Treatment :-

Raw river water (117 MLD) : to be abstracted from river Rupnarayanpur at Mirpur/Ichapur of Nandakumar Block and pumped to the WTP(Water Treatment Plant) site at Mouza-Jalpai & Sitalpur for treatment in WTP as per process description and finally treated water to be supplied to Nandakumar, Chandipur, Nandigram-I & Nandigram-II Block in East Medinipur District through the supply pipeline.

C. Solid Waste :- WTP sludge to be used for landfilling and PVC/Plastic waste /gunny bags to be sold.

D. General :-

1. The unit shall take proper measures to control air, water and noise pollution.
2. This NOC is valid only subject to obtaining permission/clearances from the other Competent Authorities as applicable.
3. Ambient noise level not to exceed the permissible limit.
4. No addition/alteration/modification can be done without prior permission from the State Board.
5. The unit shall obtain Consent to Operate of the State Board before starting operation.
6. Good housekeeping to be maintained.
7. Adequate green belt around the unit to be developed.
8. This NOC is valid upto **31.10.2027** for setting up the Water Treatment Plant – 117 MLD capacity.


Environmental Engineer
West Bengal Pollution Control Board
Environmental Engineer
W. B. Pollution Control Board
Operation & Execution Cell

CTE Compliance

Sl. No.	General Conditions of NOC for WTP	Compliance Status	Remarks
1	The quality of sewage and trade effluent to be discharged from your factory shall satisfy the permissible limits as prescribed in IS: 2490 (Pt 1) of 1974, and /or its subsequent amendment and Environment (Protection) Rules 1986.	Will be complied	Operation not yet started
2	Suitable measures to treat your effluent shall be adopted by you in order to reduce the pollution at load so that the quality of the effluent satisfies the standards mentioned above.	Will be complied	Operation not yet started
3	You shall have to apply to this Board for its consent to operate and discharge of sewage and trade effluent according to the provisions of the water (Prevention & Control of Pollution) Act. 1974. No sewage or trade effluent shall be discharged by you without prior consent of this Board.	Will be complied	CTO will be obtained before start of operation stage
4	All emissions from your factory shall conform to the standards as laid down by this Board.	Complied	Ambient air, noise has been monitored
5	No emission shall be permitted without prior approval of this Board and you shall apply to this Board for its consent to operate and atmospheric emission as per provision of the Air (Prevention & Control Pollution) act, 1981.	NA	This is a construction project, fossil fuels not using here as a fuel.
6	No industrial plant, furnace. flues, chimneys., control equipment, etc. shall be constructed/ reconstructed/ erected/ re-erected without prior approval of this Board.	NA	This is a WTP construction project.
7	You shall Comply with:		
	(i) Water (Prevention and Control of Pollution) Cess Act, 1977, if applicable.	N.A	
	(ii) Water (Prevention and Control of Pollution) Cess Act, 1978, if applicable.	N.A	
	(iii) Environment (Protection) Act, 1986	Complied	
	(iv) Environment (Protection) Rules, 1986	Complied	
	(v) Hazardous Wastes (Management and Handling) Rules, 1989 and Amended Rules, 2000	Complied	Hazardous materials like diesel have been stored in separate container
	(vi) Manufacture, Storage and Import of Hazardous Chemicals Rules, 1989 and Amended Rules, 2000	N.A	
	(vii) Manufacture, Use, Import and Storage and Hazardous Micro-Organisms, Genetically Engineered Organisms or Cell Rules. 1989	N.A	
	(viii) The Public Liability Insurance Act, 1991 and Amended Act, 1992	N.A	
	(ix) The Public Liability Insurance Rules, 1991 and Amended Rules, 1993	N.A	


Sl. No.	General Conditions of NOC for WTP	Compliance Status	Remarks
	(x) Biomedical Wastes (Management & Handling) Rules, 1998 and Amended Rules 2000, if applicable.	N.A	
	(xi) Recycled Plastics Manufacture and Usage Rules 1999, if applicable and	N.A	
	(xii) Ozone Depleting Substances (Regulation & Control) Rules 2000, if applicable	N.A	
SPECIAL CONDITION:			
A.	Emission - Nil	Complied	Ambient air has been monitored
B.	Raw Water Treatment		
	Raw river water: 117 MLD to be abstracted from river Rupnarayan at Mirpur/Ichapur of Nanadakumar Block and pumped to the WTP site at Sitalpur-Jalpai mouza for treatment in WTP and finally treated water to be supplied to Nandakumar, Chandipur, Nandigram I & II	Complied	Extraction permission has been obtained from Inland and Waterways Department
C.	Solid Waste: WTP sludge to be used for landfilling and PVC/Plastic waste /gunny bags to be sold.	Complied	Sludge during piling at WTP is being used for filling low laying land
D	General:		
	1. The unit shall take proper measures to control air, water and noise pollution.	Complied	Water sprinkling has been done at WTP and Intake. Also, ambient noise has been monitored.
	2. This NOC is valid only subject to obtaining permission/clearances from the other Competent Authorities as applicable.	Noted	
	3. Ambient noise level not to exceed the permissible limit.	Complied	Ambient noise has been monitored.
	4. No addition/alteration/modification can be done without prior permission from the State Board.	Complied	
	5. The unit shall obtain Consent to Operate of the State Board before starting operation.	Will be complied	CTO will be obtained before start of the operation stage
	6. Good housekeeping to be maintained.	Partially Complied	Dust bin has provided at WTP
	7. Adequate green belt around the unit to be developed.	Will be complied	
	8. This NOC is valid upto 30.10.2027 for setting up the Water Treatment Plant - 117 MLD capacity.	Will be complied	

CTO of Ready Mix Concrete production unit- Batching plant

West Bengal Pollution Control Board

Paribesh Bhawan, 10A, Block-LA, Sector-III,
Bidhannagar, Kolkata-700 098

Co-105236
Certificate for 'Consent to Operate'



No. *1526/POL/DIC/HOW/2022-23* Date: *13/03/2023*

GREEN CATEGORY

The West Bengal Pollution Control Board hereby grants its 'Consent to Operate' under section 25 & 26 of the water (Prevention & Control of Pollution) Act, 1974 and under section 21 of the Air (Prevention & Control of Pollution) Act, 1981 and the Rules and Orders made thereunder to M/s M/S OMKAR INFRACON PVT. LTD. for its unit located at VILL & P.O.- Barunda, P.S.- Bagnan, Howrah- 711303 to run the industrial plant and to manufacture /store / install U. Drain & U. Drain Cover * for a period from 01-03-2022 to 28-02-2029 to operate the industrial plant and to discharge liquid effluents through outlets / outfalls and to emit the gaseous emission in accordance with the conditions as mentioned below provided on any day at any instant the quantity and quality of liquid discharge and gaseous emission shall not exceed the permissible limit as specified in the Environment (Protection) Act, 1986.

* 450 MM, 600 MM (Cement Products)


Breach of the conditions and / or failure to comply with the directions / conditions as stated below shall render the applicant liable for prosecution under the provisions of Water (Prevention & Control of Pollution) Act, 1974 and Air (Prevention & Control of Pollution) Act, 1981.

The State Board reserves its right to revoke, withdraw or make any reasonable variation of the conditions of or change or alter this consent by giving one month's notice to the applicant.

Conditions *capital investment - Rs 4.00 Crore (approx)*

01. The Applicant shall be responsible for the quantity and quality of liquid effluent and gaseous emissions.
02. The Applicant shall maintain the quality of liquid effluent discharge and air emissions and noise levels within statutory limits as mentioned in Environment (Protection) Act, 1986.
03. The Applicant shall submit analysis reports of the testing of liquid effluent and air emissions by Board-recognised laboratories with their applications, incase of any, discharge / Emission is involved in the process of manufacture.
04. To bring into any change in industrial plant, furnace, flues, chimneys, place and/or point of discharge of liquid and gaseous effluents, pollution control equipments the Applicant shall obtain prior permission of the Board in the regard.
05. The Applicant shall maintain good house keeping, good working condition and take adequate measures for control of pollution from all sources.
06. The Applicant shall bring about at least 33% of the available open land under green coverage/plantation.
07. The Applicant shall control the fugitive emissions from the activity are so as to maintain clean and safe environment in and around the factory premises.
08. The Applicant shall provide drainage system of conveying liquid wastes.
09. The Applicant shall allow the officers of the Board to enter into the applicant's premises at any reasonable time for inspecting the unit.
10. The Applicant shall make an application to the State Board in the prescribed form for renewal of the consent at least 30 days before the date of expiry of this consent.
11. The solid waste generated within the factory premises, sweepings etc. be disposed off scientifically so as not to cause any nuisance / pollution.
12. The Applicant should adopt adequate precautionary measures to prevent any inconvenience or annoyance to the denizens of the locality due to its activity or be a cause for environmental concern.
13. In case of using Diesel Generator, adequate precautionary measures to be taken as per norms fixed up by CPCB.

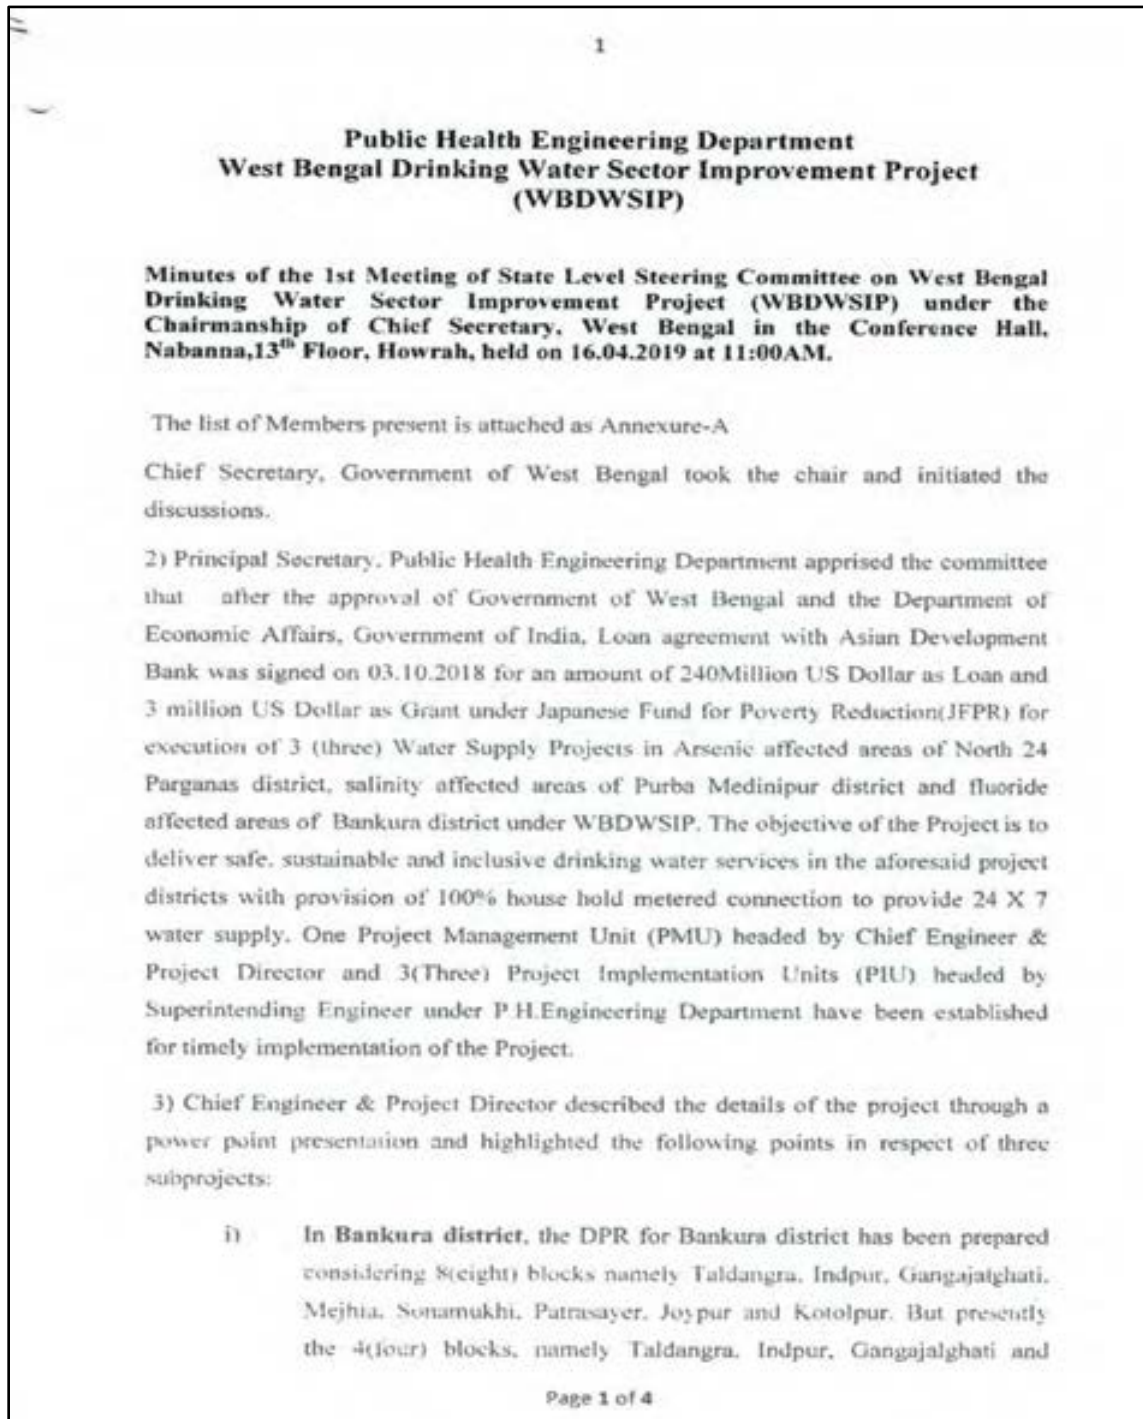
14. Fire & other statutory licences to be obtained from Competent authority
For and on behalf of the West Bengal Pollution Control Board



LAND CONVERSION CERTIFICATE
IS TO BE OBTAINED FROM
APPROPRIATE AUTHORITY

13/03/23
General Manager
District Industries Centre
General Manager
District Industries Centre,
West Bengal Pollution Control Board
CC-Office Environment Officer of WBPCB

APPENDIX 6: GRC NOTIFICATIONS AND COMMITTEE State & District Level Steering committee



Mejhia will be covered fully through piped water supply with the financial assistance from ADB. The proposal for remaining 4(four) blocks will be taken up with ADB for additional funding as the ADB officials advised in their *aide memoire* during their last consultation mission on 26-27 March, 2019.

- ii) In **Purba Medinipur district**, DPR for 4(four) Blocks namely Nandakumar, Chandipur, Nandigram-I and Nandigram-II has been prepared. But presently 2(Two) Blocks namely Nandigram –I and Nandigram –II will be covered fully through piped water supply with the financial assistance from ADB. But the Water Treatment Plant will be constructed for catering to all 4(four) blocks as mentioned above. The proposal for remaining 2(Two) blocks will be taken up with ADB for additional funding.
- iii) In **North 24 Parganas and South 24 Parganas districts**, Haroa and Bhangar-II blocks will be covered fully through piped water supply but Water Treatment Plant is considered for Barasat-II block also. The cost of distribution network for Barasat-II block is not considered under this Loan assignment. Now one DPR has been prepared for distribution network of Barasat-II Block for proposal initiation with ADB.
- iv) Presently 4 (four) Consultancy firms and 3 (three) NGOs have been engaged to assist PMU and 3(three) PIUs as per ADB approved Project Administration Manual (PAM). Moreover, Technical Assistance (TA) Consultant has also been engaged by the ADB for Smart Water Management.
- v) Purchase of Private land for construction of Intake Structure, Water Treatment Plant and Overhead reservoirs is under process for all the schemes. The land parcels lying with other Government Department are also being processed for Inter Departmental Transfer. All efforts will be taken to get the required parcels of land in possession of PHED well in advance so that project implementation is not affected for want of site at any stage.
- vi) Communication has been made with WBIDC for issuance of confirmation to Damodar Valley Reservoir Regulatory Commission

(DVRRC) regarding drawal of 70MLD water from Durgapur Barrage to get the drawal permission from DVRRC. The same was issued by WBIDC on 29.06.2018 addressed to Member Secretary DVRRC but DVRRC again asked for reconfirmation regarding the present requirement. The matter will be taken up again with WBIDC and also referred to me&W Department for taking up with DVRRC for expeditious action.


- vii) Postings of Sr. Accounts Officer at PMU and Accounts Officer at PIU-Purba Medinipur is required to be made on urgent basis as the loan disbursement and expenditures have already been started. The ADB officials highlighted the issue during their last mission. AGWB has already replied that there is no sanctioned post of Sr Accounts Officer/Accounts Officer under the Administrative Control of Works Miscellaneous Section and no scope to provide any regular Sr A.O./A.O. for the post. Proposal for re-designation of Sr Accounts Officer/Accounts Officer Post as Divisional Accounts Officer have been submitted to Finance Department for approval in consultation with the Financial Advisor, PHE Department. The Additional Secretary, Finance Department informed that he will look into the proposal of PHED.
- 4) Additional Chief Secretary, Irrigation and Waterways Department assured that the issues related to I & W Department will be taken care of on priority basis for smooth implementation of the project.
- 5) Additional Chief Secretary, Panchayets & Rural Development Department informed that necessity of piped water supply in other water quality affected blocks of North 24 Parganas, South 24 Pargana, Purba Medinipur and Bankura districts also needs to be looked into on urgent basis. The Principal Secretary, PHE Department informed that at present PHE Department has taken up a few surface water based water supply schemes which include ADB and JICA assisted schemes to provide safe and sustainable drinking water in the quality affected blocks of West Bengal under different Programmes which will be commissioned within the next 2 to 3 Years. The present population

covered through piped water supply scheme in west Bengal is about 58% and once the ongoing schemes are commissioned the coverage would reach 72%.

- 6) Principal Secretary, PHE Department proposed that the Principal Secretaries of P.W. Department, Land and Land Reforms Department and Urban Development & Municipal Affairs Departments may also be incorporated as members of the committee for more effective coordination and collaboration for timely commissioning of projects. In addition, Superintending Engineer/Executive Engineer, PWD, PW (Roads) and ADM (LR)/ DLLRO of the Project districts may also be included as invitee members of the District Level Steering Committee. The Chief Secretary agreed with the proposal. The revised list of members of State Level and District Level Steering Committee is attached as Annexure-B.

Chief Secretary advised that PHED must prepare an action plan and shelf of projects so that the entire state is covered with piped water supply schemes within the next 6 to 7 years by fixing priority in the quality affected blocks. He further advised that proposals for the remaining blocks to be covered under this project may be initiated by the PHE Department as early as possible.

There being no other issues for discussion, the meeting ended with vote of thanks to and from the Chair.


(Malay Kr. De, IAS)

Chief Secretary
Government of West Bengal

Memo no. PMU/WBDWSIP/PHEd/104/ 356(1-9) Dated Kolkata the 07.05.2019

Copy forwarded for information to:

1. P.A. to the Chief Secretary, Govt. of West Bengal. For kind information of the Chief Secretary.
2. P.A. to the Additional Chief Secretary, I & W Department. For kind information of the Additional Chief Secretary.
3. P.A. to the Additional Chief Secretary, P & R Department. For kind information of the Additional Chief Secretary.
4. P.A. to the Additional Chief Secretary, Finance Department. For kind information of the Additional Chief Secretary.
5. P.A. to the Principal Secretary, PHE Department. For kind information of the Principal Secretary
6. P.A. to the Principal Secretary, Public Works Department. For kind information of the Principal Secretary.
7. P.A. to the Principal Secretary, Urban Development & Municipal Affairs Department. For kind information of the Principal Secretary.
8. P.A. to the Principal Secretary, Land and Land Reforms Department. For kind information of the Principal Secretary.
9. P.A. to the Engineer-in-Chief, PHE Department. For kind information of the Engineer-in-Chief.

AK.
07.05.19
Chief Engineer & Project Director
PMU, WBDWSIP, PHE Dte
Government of West Bengal

Memo no. PMU/WBDWSIP/PHEd/104/ 356(1-30) Dated Kolkata the 07.05.2019

Copy forwarded for information and necessary action to:

1. The District Magistrate, North 24 Parganas/South 24 Parganas/Purba Medinipur/Bankura.
2. The Additional District Magistrate (LR)/DLLRO, Land and Land Reforms Department, North 24 Parganas/ South 24 Parganas/Purba Medinipur/Bankura.
3. The Additional Executive Officer, North 24 Parganas/South 24 Parganas/ Purba Medinipur/Bankura Zilla Parisad.
4. The Superintending Engineer, PIU, North 24 Parganas/Purba Medinipur/Bankura, WBDWSIP, PHED
5. The Superintending Engineer, Western Highway Circle-II/South Western Highway Circle/Eastern Highway Circle/ Southern Highway Circle, PW (Roads) Dte.
6. The Superintending Engineer, Western Circle II/ South Western Circle, PWD
7. The Superintending Engineer, Metropolitan Drainage Circle-I / Eastern Circle / Kangsabati Circle-I, Bankura / Western Circle-II, Medinipore/ Damodar Irrigation Circle, Irrigation and Waterways Dte.
8. The Executive Engineer, PIU, North 24 Parganas/ Purba Medinipur/ Bankura, PHE Dte
9. The Executive Engineer, Barasat Highway Division -I/ South 24 Parganas Highway Division /Tamluk Highway Division/ Bankura Highway Division, PW (Roads) Dte.
10. The Executive Engineer, Tamluk Division/ Bankura Division, PWD
11. The Executive Engineer, Contai Division/ Kangsabati Canal Division -I/ Damodar Headworks, I & W Dte.

AK.
07.05.19
Chief Engineer & Project Director
PMU, WBDWSIP, PHE Dte
Government of West Bengal

Meeting on 16.04.2019- 1st State Level Steering Committee

Subject:-WBDWSIP

Venue:-CS- Conference hall, Nabsanna

Time:-11:00am

Attendance Sheet: -

Sl. No	Name	Signature	Email
1	Chief secretary		
2	Additional Chief Secretary, P & RD Department		
3	Additional Chief Secretary, I & WD Department		
4	Additional Chief Secretary, Finance Department		
5	Principal Secretary, PHE Department		
6	Engineer- in - Chief, PHED		
7	Chief Engineer & P. D. WBDWSIP, PHE & Addl. Secretary, Finance		pd.pmu.adb@wbphed.gov.in
8	Dr. Sudip K. Sinha		sudipkumar.sinha@yahoo.in
9	Subhanis Ray		se.pmu@wbphed.gov.in
10	Dobroho Bhowmik		SE PMU PHED
11	Sujoy Barua		SE/PIU, Bankura
12	Nityananda Khan		SE/ME/PMU, semi.pmu.adb@wbphed.gov.in
13	Saunak San		cas.pmu.adb@wbphed.gov.in
14			
15			
16			

Annexure-B

A. Restructured State Level Steering Committee for ADB Assisted Project (WBDWSIP) under PHE Department.

Members of the State Level Steering Committee :-

1	The Chief Secretary, Govt. of West Bengal-	Chairperson
2	The Principal Secretary / Additional Chief Secretary, PHE Department-	Member
3	The Principal Secretary / Additional Chief Secretary, P & RD Department	Member
4	The Principal Secretary/ Additional Chief Secretary, Finance Department	Member
5	The Principal Secretary/ Additional Chief Secretary, I & W Department	Member
6	The Principal Secretary/ Additional Chief Secretary, Public Works Department	Member
7	The Principal Secretary/Additional Chief Secretary, Urban Development & Municipal Affairs Department	Member
8	The Principal Secretary/ Additional Chief Secretary, Land and Land Reforms Department	Member
9	The Engineer-in-Chief, PHE Department	Member
10	The Project Director, WBDWSIP, PHE Directorate	Member Secretary
11	The District Magistrate (each District)	Invitee Member

B. Restructured District Level Steering Committee for ADB Assisted Project (WBDWSIP) under PHE Department

Members of the District Level Steering Committee :-

1	The District Magistrate	Chairperson
2	The Additional District Magistrate/DLLRO, Land and Land Reforms	Member
3	The Additional Executive Officer, Zilla Parisad	Member
4	The Superintending Engineer, PIU (each PIU). PHE Dte	Member Secretary
5	The Superintending Engineer/Executive Engineer, PW (Roads)	Member
6	The Superintending Engineer/Executive Engineer, PWD	Member
7	The Superintending Engineer/Executive Engineer, I & WD	Member
8	The Executive Engineer, (PIU), PHE Dte	Member
9	The Assistant Engineer, Social Safeguard (PIU) PHE Dte	Member
10	The Block Development Officer (each Block)	Member
11	Representative of NGO	Invitee Member

PMU LEVEL

Grievance Redressal mechanism M.NO-418/PIU, 01-21-0
Social Safeguard
FF(Civil) PIU,
New Pym PI

1827
23-05-2019

Superintending Engineer,
PIU, North 24-Parganas
WBDWSIP, P.H.E. Dte.
Govt. of West Bengal

1

Government of West Bengal
Public Health Engineering Directorate
Project Management Unit, West Bengal Drinking Water Sector Improvement Project
Utility Building, 1st Floor, (Premises No.-09/1-0024)
AA-1A, (Tank No.-3), New Town Kolkata-700 156
Phone No.-(033) 2324-2095, E-mail.: pd.pmu.adb@wbphed.gov.in;
pmu.adb@wbphed.gov.in

19.5.19

27/5/19

Open to Grievance
Social Safeguard
27/5/19

Memo No. PMU/WBDWSIP/PHED/2019/380 Date: 16.05.2019.

NOTIFICATION

In order to address social, environmental and any other project or sub project related grievances in the implementation of Piped water supply schemes in the districts of Bankura, North & South 24 Parganas, Purba Medinipur under West Bengal Drinking Water Sector Improvement Project, PHE Dte with the assistance of Asian Development Bank (ADB), a common grievance redress mechanism has been developed for Project Management Unit.

The following members constitute the Grievance Redressal Committee to resolve the grievances at the PMU level:

1. Chair person- Chief Engineer & Project Director ,PMU
2. Member-Superintending Engineer (Civil), PMU
3. Member-Superintending Engineer (Mech/Elec), PMU,
4. Safeguards and Gender Officer, Safeguards Gender Cell- Executive Engineer-I PMU.

The functions of GRC at PMU level are as follows:-

1. Accept Grievances of the Aggrieved parties through telephone hot lines at accessible location, email, post at PMU office
2. Address and Facilitate resolution of Grievances not resolved at the field and PIU level within stipulated time.
3. PMU HSGO together with PIU safeguard officers will have the joint responsibility for timely grievance redress on safeguards and gender issues and for registration of grievances, related discloser, and communication with the aggrieved party.
4. Resolve grievances and suggest corrective measures or solutions for their redressal to PIU for implementation within the specified time (within 15 days).
5. If grievances cannot be resolved at the project level they will be referred to the District Steering Committee (DSC), which will also act as Grievance Redressal Committee particularly in matters related to land purchase and or acquisition, payment of compensation, and environmental pollution among others.

6. Any matter deemed higher than the district level or that may require inter departmental coordination, the required grievances redress will be referred to the state level steering committee.
7. Careful documentation of the name of the complainant and date of receipt of complaint, address and contact details of complainant, location of the problem area and how the problem was resolved and report the same in the Quarterly Progress Report and Semi Annual Safeguard Monitoring report to be submitted to ADB.
8. Periodically Review the functioning of the GRM at the field and PIU level.

The GRC will continue to function throughout the project duration.

At, 16.05.19 ✓
Chief Engineer & Project Director,
PMU, WBDWSIP, P.H.E. Dte.,
Govt. of West Bengal.

Memo No. PMU/WBDWSIP/PHED/...../.....

Date: 16.05.2019.

Copy forwarded for information to :-

1. The Superintending Engineer, Civil / (M/E), PMU, WBDWSIP, PHE Dte.
2. The Superintending Engineer, PIU, North 24 Parganas/ Purba Medinipur / Bankura, WBDWSIP, PHE Dte. with a directive to constitute the GRC at the PIU level and Field level as suggested in PAM approved by ADB.
3. The Executive Engineer-I, PMU, WBDWSIP, PHE Dte.
4. The Executive Engineer, PIU, North 24 Parganas/ Purba Medinipur/Bankura, WBDWSIP, PHE Dte.

At, 16.05.19 ✓
Chief Engineer & Project Director,
PMU, WBDWSIP, P.H.E. Dte.,
Govt. of West Bengal.

SAFEGUARD AND GENDER CELL PMU



West Bengal Drinking Water Sector Improvement Project
(Asian Development Bank funded)
PROJECT MANAGEMENT UNIT
Public Health Engineering Department,
Government of West Bengal
Utility Building, 1st Floor, AA-1A (Tank No. 3), New Town, North 24 Parganas, - 700156



Memo No. PMU/WBDWSIP/PHED/94/356

Dated : 01-04-2024

OFFICE ORDER

Public Health Engineering Department (PHED) has established a dedicated "Safeguard and Gender Cell(SGC)" at Project Management Unit (PMU) level to ensure the implementation of Environmental and Social Safeguards as per ADB's Safeguard Policy Statement (SPS), 2009 and requisite requirements under Loan No.3696-IND.

Environment, Social and GESI- PMU

	Designation	Name	Contact details	Status
1	Superintending Engineer (Civil), PMU, WBDWSIP, Head SO5	Mr.Subhabrata Kundu	+91-9163236066	Available since- January 2024
2	Environment Specialist, PMC	Dr. Ardhendu Mitra	+919830415953	Available since- December 2018
3	Social, Gender & Resettlement Specialist, PMC			


AYESHA RANI A, IAS
Sr. Special Secretary, PHED and
Project Director, PMU, WBDWSIP

Memo No. PMU/WBDWSIP/PHED/94/356

Dated : 01-04-2024

Copy forwarded for information to :

- 1) Chief Engineer, PMU, WBDWSIP, PHED
- 2) Superintending Engineer, (Civil), PMU, WBDWSIP, PHED
- 3) Superintending Engineer, (M/E), PMU, WBDWSIP, PHED
- 4) The Executive Engineer -I /II, PMU, WBDWSIP, PHED
- 5) All PIUs, North 24 Paragans, /Bankura/ Purba Medinipur
- 6) Dy. Team Leader, PMC / Dr. Ardhendu Mitra, Environmental Specialist, PMC /


AYESHA RANI A, IAS
Sr. Special Secretary, PHED and
Project Director, PMU, WBDWSIP

NORTH 24 PGS
PIU Level GRC- North 24 pgs



GOVERNMENT OF WEST BENGAL
OFFICE OF THE SUPERINTENDING ENGINEER
P.L.U., NORTH 24 PARGANAS WEST BENGAL DRINKING
WATER SECTOR IMPROVEMENT PROJECT
PUBLIC HEALTH ENGINEERING DIRECTORATE
UTILITY BUILDING, 3RD FLOOR, (PRIMISES NO.-09/1-0024)
AA-IA (TANK NO. 3), NEW TOWN, KOLKATA-700156
Email : se.piun24p.adb@wbphed.gov.in

Memo No.

/PIUN24PGS

Dated :

NOTIFICATION

In order to address social, environmental and any other project or sub project related grievances in the implementation of Asian Development Bank (ADB) assisted Piped water supply schemes in the district of North 24 Parganas under West Bengal Drinking Water Sector Improvement Project (WBDWSIP), a project level Grievance Redress Mechanism (GRM) has been developed for the Project Implementation Unit (PIU), North 24 Parganas, WBDWSIP, PHE Dte. and the Grievance Redress Committee (GRC) has been constituted with the following members to resolve the grievances at the PIU level:


Status in the GRC	Designation	Contact No.
Member	Assistant Engineer and Officer, Safeguard & Gender (Responsible for Haroa), PIU, North 24 Parganas, WBDWSIP, PHE Dte	033 2324 2051 (Extn. 204)
Member	Assistant Engineer (Responsible for WTP), PIU, North 24 Parganas, WBDWSIP, PHE Dte.	033 2324 2051 (Extn. 202)
Member	Assistant Engineer (Responsible for Bhangar-II), PIU, North 24 Parganas, WBDWSIP, PHE Dte.	033 2324 2051 (Extn. 203)
Member	Junior Engineer and Asst. Officer, Safeguards (Responsible for Haroa), PIU, North 24 Parganas, WBDWSIP, PHE Dte.	033 2324 2051 (Extn. 205)
Member	Junior Engineer and Asst. Officer, Gender (Responsible for WTP), PIU, North 24 Parganas, WBDWSIP, PHE Dte.	033 2324 2051 (Extn. 210)
Member	Junior Engineer (Responsible for Bhangar-II), PIU, North 24 Parganas, WBDWSIP, PHE Dte.	033 2324 2051 (Extn. 211)

Note : This is in accordance to the structure enumerate in PAM.

The function of GRC at PIU level are as follows-

1. Being assisted by the Design Supervision & Institutional Support Consultants (DSISC) the PIU will disseminate information and awareness campaigns on grievance redress procedures.
2. Brief the contractors on GRM with support from DSISC.
3. Accept grievances of the aggrieved person(s) in the grievance redress form (as specified in Appendix 6 of PAM).
4. Careful documentation of the name of the aggrieved person(s), date of receipt of the grievance, address/ contact details of the aggrieved person, location of the problem area etc.

5. Address and facilitate resolution of grievances not resolved at the field level within stipulated time (7 days).
 6. The Officer, Safeguard & Gender, PIU, North 24 Parganas supported by the Social, Gender & Resettlement Specialist of DSISC, North 24 Parganas will be responsible for conducting meeting with the affected/ aggrieved person(s) to understand their concerns and help them through the process of grievance redressal including translating the complaints into Bengali or English, recording and registering grievances of non-literate affected persons and explaining the process of grievance redress mechanism.
 7. If the PIU level GRC fails to resolve the grievance, the matter may be conveyed to the GRC established within PMU and the actions suggested by them to be taken up/ followed by this GRC.
 8. Ensure redress of grievances on safeguards and gender issues and for registration of grievances, related disclosure and communication with the aggrieved party.
 9. If grievances cannot be resolved at the PIU level, they will be referred to the District Steering Committee (DSC), acting as the GRC.
 10. Any matter deemed higher than the district level or that may require inter-departmental coordination, the required grievance redress will be referred to the State Level Steering Committee (SLSC).
 11. The GRC at PIU, North 24 Parganas will also be responsible for follow-through for each grievance, periodic information dissemination to the aggrieved person(s) on the status of their grievances and recording their feedback (satisfaction/ dissatisfaction and suggestions).
 12. Periodically Review the functioning of the GRM at this end as well as field level.
- The GRC will continue to function throughout the project duration.



Superintending Engineer
P.I.U., North 24 Parganas, WBDWSIP
Public Health Engineering Directorate
Govt. of West Bengal

Dated : 20.05.19

Memo No. 409/(1-12) /PIUN24PGS

Copy forwarded for information to :-

1. The Chief Engineer & Project Director, PMU, WBDWSIP, PHE Dte.
2. The Dy. Superintending Engineer, PIU, North-24 Pgs., WBDWSIP, PHE Dte.
3. The Executive Engineer (Civil), PIU, North 24 Parganas, WBDWSIP, P.H.E. Dte.
4. The Executive Engineer (Elec./Mech.), PIU, North 24 Parganas, WBDWSIP, P.H.E. Dte.
5. The Executive Engineer-I and Head Safeguard & Gender Officer, PMU, WBDWSIP, P.H.E. Dte.
6. The Assistant Engineer-I / II, PIU, North 24 Parganas, WBDWSIP, P.H.E. Dte.
7. The Assistant Engineer and Officer Safeguard & Gender, Sub Divn.-I under PIU, North 24 Parganas, WBDWSIP, P.H.E. Dte.
8. Sri Shyamalendu Debadhikari, Junior Engineer, PIU, North 24 Parganas, WBDWSIP, P.H.E. Dte.
9. The Junior Engineer and Junior Safeguard & Gender Officer, PIU, North 24 Parganas, WBDWSIP, PHE Dte.
10. The Junior Engineer and Junior Environmental Officer, PIU, North 24 Parganas, WBDWSIP, P.H.E. Dte.
11. The Team Leader, DSISC, North 24 Parganas.
12. The Social / Gender / Resettlement Specialist, DSISC, North 24 Parganas.


Superintending Engineer
P.I.U., North 24 Parganas, WBDWSIP
Public Health Engineering Directorate
Govt. of West Bengal

Field level GRC- North 24 pgs

West Bengal Drinking Water Supply Improvement
Project, WBPHE Directorate

DESIGN, CONSTRUCTION SUPERVISION AND
PROJECT IMPLEMENTATION SUPPORT
CONSULTANTS (DSISC), N 24 Parganas
E-mail: n24dsiscstup@gmail.com

b/c

STUP Consultants Pvt. Ltd.
JV with SHAH Technical Consultants Pvt.
Ltd.
Address:
Utility Building, 2nd and 3rd floor,
Premises No. 09/1-0029, AAJA (Tank No. 3),
New Town, North 24 Parganas, WEST BENGAL



Letter No: DSISCN24P/TL/2019/ 514

Date: 12.06.2019

To
Executive Engineer
PIU, North 24 Parganas, WBDWSIP,
2nd Floor, Utility Building, Tank No - 3
Action Area - 1A, New Town, Kolkata
Pin: 700156, West Bengal

Sub: Design and construction of overhead reservoir including water supply distribution network & metering works in Haroa & Bhangar- II Blocks (Contract Package No. WBDWSIP/DWWW/NCB/N24P/02A&02B/2017-2018) – **Field Level GRM**

Dear Sir,

We refer to the organization structure of the proposed Field Level grievance redress mechanism and herewith nominate our following mentioned key experts as DSISC representatives:

- Social, Gender and Resettlement Specialist, and
- Environmental Specialist.

Necessary notification may please be made in this regard.

Thanking you

Yours Sincerely,

12/06/19
Team Leader, DSISC
North 24-Parganas, WBDWSIP

**Team Leader, DSISC
North 24 Parganas
WBDWSI Project**

Copy forwarded for information to :-

1. The Superintending Engineer, PIU, North 24 Parganas, WBDWSIP, PHE Dte
2. The Assistant Engineer, N24P, W/S- Sub Divn-I, Under North 24 Parganas, PHE Dte.
3. The Assistant Engineer – II, North 24 Parganas, W/S- Divn- II, PHE Dte.



STUP Consultants P. Ltd

12.06.19
RECEIVED
(Contents Not Verified)
Receiving Clerk
North 24 Parganas W/S Divn-II
PHE Engg. Dte.

12.06.19
Received
(Contents not verified)
Receiving Clerk
North 24 Pgs. W/S Sub Divn-II
Under North 24 Pgs. W/S Divn-II, PHE, Dte
Govt of West Bengal



Memo No - 953 / N.M.K.S.P-II dated - 13/06/2024



TH/DSIS
[Signature]
Executive Engineer
N.M.K.S.P. II
PHE, Govt. of W.B.

NCC

Ref: NCC/WB/EWS-HAROM/2019-20/143

Date: 13/06/24

To:
The Executive Engineer,
PH, North 24 Parganas, WBDWSIP,
PHE Directorate, Government of West Bengal,
2nd Floor, Utility Building, Tank no.3, Action Area-1A
New Town, Kolkata-700 150, West Bengal.

Sub: "Design and Construction of Overhead Reservoir including Water Supply Distribution Network and Metering Works in Lucha Block", Reg. Field Level GRM

Ref.No. : Agreement Memo No: PMO/ WBDWSIP/PHE/58/850

Dear Sir,

We refer to the organization structure of the proposed Field Level Grievance Redress Mechanism and accordingly propose the following mentioned key personnel as NCC representatives: Junior Engineer (Safety), responsible for Hazar, with Contact No - 9775459187.

Necessary notifications may please be made in this regards.

Thanking you and assuring our best services at all time.

Yours Faithfully
For, **NCC LIMITED**
(Formerly, Nagajuna Construction Company Limited)

[Signature]
Ramesh Kumar Singh
Project Manager

file
[Signature]

Copy forwarded to:

1. The Superintendent Engineer, PH, 3rd Floor, North 24 Parganas, WBDWSIP, PHE Div.
2. The Asst. Engineer, SD-1, PH, 2nd Floor, WBDWSIP, PHE Div.
3. Team Leader, DS SC, North 24 Parganas, WBDWSIP

DSIS / WBDWSIP
Inward No 1000
RECEIVED
Date _____ Signature _____

NCC Limited
Newly Nagar/Caroline Gardens, West
BDO Space Business Park, Block-4A, 5th Floor
Action Area-II, New Town, Kolkata - 700 156
Phone : (57) 4020-8688, Fax : (583) 4020-6021
CIN No - 172900507 OMBPLG311146



NCC

Ref: NCC/W&E/WSS-BHANGAR/2019-200455

Date: 13.06.19

To,
The Executive Engineer,
PIU, North 24 Parganas, WBDWSIP,
PHE Directorate, Government of West Bengal,
3rd Floor, Utility Building, Tank no. 3, Action Area-1A,
New Town, Kolkata-700156, West Bengal.

Sub: "Design and Construction of Overhead Reservoir including Water Supply Distribution Network and Metering Works in Bhangar-II Block". **Reg. Field Level GRM**

Ref. No. L/Agreement/Memo No: PMC/ WBDWSIP/PHE/D/37/851


Dear Sir,

We refer to the organization structure of the proposed Field Level Grievance Redress Mechanism and herewith nominate our following mentioned key personnel as NCC representatives: Safety Officer, responsible for Bhangar-II with Contact No. 8971107720.

Necessary notifications may please be made in this regards.

Thanking you and assuring our best services at all time.

Your Faithfully,
For NCC LIMITED
(Formerly, Nagarjuna Construction Company Limited)


Anoop Kumar
Dy. General Manager

*File
slip
27/06*

Copy forwarded to:

1. The Superintending Engineer, PIU, 3rd Floor, North 24 Parganas, WBDWSIP, PHE Div.
2. The Asst. Engineer, PIU, SD-II, 2nd floor, WBDWSIP, PHE Div
3. Team Leader, DSISC, North 24-Parganas, WBDWSIP



NCC Limited
Formerly Nagarjuna Construction Company Limited
ECO Space Business Park, Block-4A, 5th Floor,
Action Area-II, New Town, Kolkata - 700 155
Phone : (033) 4029-8888, Fax : (033) 4029-8827
CIN No. - L72200AP1990PLC011145

DSISC / WBDWSIP
Inward No 1012
RECEIVED

Date 13/6/19

Tomar 12:04 PM

FFJ

FFIL - RIL JV

Ref.: Ref.: FFIL-RIL JV/ K201810003/ Vol.-II /088

Date: Date: June 13, 2019

To,
Executive Engineer, North 24 Parganas, Divn. - II
Project Implementation Unit (PIU),
West Bengal Drinking Water Sector Improvement Project,
Public Health Engineering Department,
Government of West Bengal
2nd Floor, Utility Building, Tank No.-3, Action Area- 1A,
New Town, Kolkata 700156, West Bengal

Sub: Design Construction & Operation of Water Treatment Plant, Reservoir, Transmission Mains & Pumping Stations works in Haroa, Rajahat & Bhangan-II (Ref.: Contract No- WBDWSIP/ DWW/ N24P/ NCB/01/2017-18) - Field Level GRM

Dear Sir,

We refer to the organization structure of the proposed Field Level Grievance Redress Mechanism and herewith nominate our following mentioned key personnel as FFIL-RIL JV representatives: Safety Officer responsible for WTP with Contact No: +91 6292128031.

Necessary notifications may please be made in this regard.

Thanking you and assuring you of our best efforts at all the times.

For FFIL - RIL JV

Sujay Das
(CCO)

Encl.: As above.

CC: 1) The Assistance Engineer-1 (PIU), North 24 Parganas, WBDWSIP, PHED.
2) The Team Leader, DSISC, North 24 Parganas, WBDWSI Project.

File
Copy 1/1/19

DSISC / WBDWSIP

Inward No. 1017

RECEIVED

Date 14/6/19

Signature

Time - 12:40 PM

1582, Rajdanga Main Road, Kasba New Market, 7th Floor, Kolkata - 700 107

Ph. No. : +91-33-30900500

Fax No. -91-33-30900888

Environment & Social Safeguard Unit- North 24 pgs



No: PMU/WBDWSIP/PHED/94/695A.

Date: 07/08/2023

OFFICE ORDER

Public Health Engineering Department (PHED) has established a dedicated Environment and Social Safeguard Unit (ESSU) at Project Implementation Unit (PIU) level, North 24 pargana to ensure the implementation of Environmental and Social Safeguards as per ADB's Safeguard Policy Statement (SPS), 2009 and requisite requirements under Loan No. 3696-IND.

Environment, Social and GESI – PIU, North 24 Parganas.

Sl. No.	Designation	Name	Contact details	Status
1	Executive Engineer, PIU, N 24 Pgs.	Mr. Subhabrata Kundu	+91-9163236033	Available since – November 2021
2	Assistant Engineer - I, PIU, N 24 Pgs.	Mr. Sk. Mozammel Haque	+91-6291880569	Available since – August 2021
3	Assistant Engineer - II, PIU, N 24 Pgs.	Mr. Prabir Kr. Naskar	+91-9433778332	Available since – April 2022
4	Dy. Team Leader, DSISC, North 24 Pgs.	Mr. Anujit Dutta	+91-9925070335	Available since – August 2022
5	Social, Gender and Resettlement Specialist, DSISC, N 24 Pgs.	Dr. Shrabani Sengupta	+91-9836022781	Available since – November 2019
6	Environmental Specialist, DSISC, N 24 Pgs.	Mr. Swarnabha Bandyopadhyay	+ 91-8017668861	Available since – December 2018

Ay
20/8/23
AYESHA RANI A, IAS
Sr. Special Secretary, PHED and
Project Director, PMU, WBDWSIP

No: PMU/WBDWSIP/PHED/94/695A.


Date: 07/08/2023

Copy forwarded for information to:
1. S.E., PIU, North 24 Parganas, WBDWSIP, PHED

Ay
20/8/23
AYESHA RANI A, IAS
Sr. Special Secretary, PHED and
Project Director, PMU, WBDWSIP

BANKURA

BANKURA PIU Level GRC Notification


51 1 97

GOVERNMENT OF WEST BENGAL
OFFICE OF THE SUPERINTENDING ENGINEER
Project Implementation Unit, Bankura, WBDWSIP, P.H.E.DTE.
RABINDRA SARANI: NEAR JAIL MORE: BANKURA: PIN – 722101
Ph No – 03242-241007, 241008:: email:
se.piubankura.adb@wbphed.in & piubankura.adb@wbphed.gov.in

Memo No. 443 /SE/PIU-Bankura Dated Bankura the 08/01/2019

NOTIFICATION

In order to address social, environmental and any other project or sub project related grievances in the implementation of Asian Development Bank (ADB) assisted Piped water supply schemes in the district of Bankura under West Bengal Drinking Water Sector Improvement Project (WBDWSIP), a project level Grievance Redress Mechanism has been developed at PIU Level for PIU, Bankura, WBDWSIP, PHE Dte with the following members.

1. Chairperson- Executive Engineer (Civil), PIU, Bankura, WBDWSIP, PHE Dte.
2. Member- Executive Engineer (E/M), PIU, Bankura, WBDWSIP, PHE Dte.
3. Assistant Safeguard and Gender Officer – Assistant Engineer, Head Quarters, PIU, Bankura, WBDWSIP, PHE Dte.
4. Assistant Environmental Officer – Assistant Engineer - I, PIU, Bankura, WBDWSIP, PHE Dte
5. Junior Safeguard and Gender Officer – Junior Engineer, PIU, Bankura, WBDWSIP, PHE Dte.
6. Junior Environmental Officer – Junior Engineer, PIU, Bankura, WBDWSIP, PHE Dte
7. Social/Gender/Resettlement Specialist, DSISC, PIU, Bankura, WBDWSIP, PHE Dte.

The function of GRC at PIU level are as follows-

1. Accept Grievances of the Aggrieved persons through grievance redress/ suggestion forms in complaints/ suggestion boxes or through telephonic hollines at accessible locations, by e-mail, by post, or by writing in a complaint register in PIU office.
2. Careful documentation of the name of the complainant, date of receipt of the complaint, address/ contact details of the aggrieved person, location of the problem area etc.
3. Address and facilitate resolution of Grievances not resolved at the field level within stipulated time (7 days).
4. The Assistant safeguard Officer, PIU, Bankura supported by the Social safeguard specialist of DSISC, PIU, Bankura will be responsible for conducting meeting with the affected/ aggrieved person (s) to understand their concerns and help them through the process of grievance redressal including translating the complaints into Bengali or English, recording and registering grievances of non literate affected persons and explaining the process of grievance redress mechanism.
5. If the PIU level GRC fails to resolve the Grievance, the matter may be conveyed to the GRC established within PMU and the actions suggested by them to be taken up/ followed by this GRC.
6. PMU HSGO together with PIU safeguard officers will have the join responsibility for timely Grievance Redressal on safeguards and Gender issues and for registration of Grievances, related disclosure and communication with the aggrieved party.
7. If Grievance cannot be resolved at the Project Level, they will be referred to the District Steering Committee (DSC) which will also act as Grievance Redressal Committee, particularly in matter related to Land purchase and or Acquisition, payment of the compensation and environmental pollution among others.
8. Any matter deemed higher than the district level or that may require inter-departmental coordination, the required Grievance redress will be referred to the State Level Steering Committee.
9. The GRC at PIU, Bankura will also be responsible for follow-through for each grievance, periodic information dissemination to complainants on the status of their grievances and recording their feedback (satisfaction / dissatisfaction and suggestions).

10. Periodically Review the functioning of the GRM at this end as well as field level.

The GRC will continue to function throughout the project duration.

Signature

06/06/19
Superintending Engineer
PIU, Bankura, WBDWSIP, PHE Dte

Memo No. 443 / SE/PIU-Bankura

Dated Bankura the 6 / 6 / 2019


Copy forwarded for information and necessary action:-

- 1) The Chief Engineer & Project Director, WBDWSIP, PHE Dte.
- 2) Executive Engineer (Civil), PIU, Bankura, WBDWSIP, PHE Dte.
- 3) Executive Engineer (E/M), PIU, Bankura, WBDWSIP, PHE Dte.
- 4) Assistant Engineer (HQ), PIU, Bankura, WBDWSIP, PHE Dte.
- 5) Assistant Engineer – I, PIU, Bankura, WBDWSIP, PHE Dte.
- 6) Junior Engineer-I, PIU, Bankura, WBDWSIP, PHE Dte.
- 7) Junior Safeguard and Gender Officer – Junior Engineer, PIU, Bankura, WBDWSIP, PHE Dte.
- 8) Junior Environmental Officer – Junior Engineer, PIU, Bankura, WBDWSIP, PHE Dte
- 9) The Team Leader, DSISC, PIU, Bankura, WBDWSIP, PHE Dte.
- 10) Social/Gender/Resettlement Specialist, DSISC, PIU, Bankura, WBDWSIP, PHE Dte.
- 11) Support Staff (I & II) – Environmental and Social Safeguards, DSISC, PIU, Bankura, WBDWSIP, PHE Dte.

Signature

06/06/19
Superintending Engineer
PIU, Bankura, WBDWSIP, PHE Dte

Field Level GRC Notification



GOVERNMENT OF WEST BENGAL
OFFICE OF THE SUPERINTENDING ENGINEER
Project Implementation Unit, Bankura, WBDWSIP, P.H.E.D.TE.
RABINDRA SARANI, NEAR JAIL MORE, BANKURA, PIN – 722101
Ph No – 03242-241007, 241008 :: email: se_bank_ws@wbphed.gov.in,
se_piubankura.adb@wbphed.in & piubankura.adb@wbphed.gov.in

Memo No. 905 /SE/PIU-Bankura Dated Bankura the 24 / 10 /2019

Notification

In order to address Social, environmental and any other project or subproject related grievances in implementation of Asian Development Bank (ADB) assisted piped water supply schemes in the district of Bankura under West Bengal Drinking Water Sector Improvement Project (WBDWSIP), a field level Grievance Redress Mechanism has been developed for different packages under this project with the following members-

1. Safeguard officer from PIU (AE, PHE) - Chairperson
2. Gram-Panchayet Pradhan of the concerned G.P - Member
3. Support Environment safeguard - Member
4. Support Social Safeguard - Member
5. Panchayet Member of the concerned G.P - Member
6. Health and Safety officer from contractor's side- Member

The function of GRC at field level are as follows: -

1. Accept Grievances of the aggrieved persons through grievance redress / suggestion forms in complaints / suggestion boxes or through telephonic hotlines at accessible locations, by e-mail, by post or by writing in a complaint register in PIU office.
2. Careful documentation of the name of the complainant, date of receipt, address / contact details of the aggrieved person, location of the problem area etc.
3. Address and facilitate resolution of Grievances within stipulated time (7 days).
4. Safety officer of Contractor supported by the Social safeguard support and Environmental Safeguard Support of DSISC, PIU, Bankura will be responsible for conducting meeting with the affected / aggrieved person(s) to understand their concerns and help them through the process of grievance redressal including translating the complaints into Bengali or English, recording and registering grievances of non – literate affected persons and explaining the process of grievance redress mechanism.
5. If the Field level GRC fails to resolve the Grievance, the matter may be conveyed to the PIU level GRC and the actions suggested by them to be taken up / followed by this GRC.
6. Field level GRC will have the primary responsibility for timely Grievance Redressal on safeguards and Gender Issues and for registration of Grievances, related disclosure and communication with the aggrieved party.

7. Field level GRC will be responsible for follow - through for each grievance, periodic information dissemination to complainants on the status of their grievances and recording their feedback (satisfaction / dissatisfaction and suggestions).

The GRC will continue to function throughout the project duration.

S. Sami 24/10/19
Superintending Engineer
PIU, Bankura, WBDWSIP, PHE Dte.

Memo No. 905/(1-84) /SE/PIU-Bankura

Dated Bankura the 24 / 10 / 2019

Copy forwarded for information to:-

1. The Chief Engineer & Project Director, PMU, WBDWSIP, PHE Dte
2. The District Magistrate, Bankura
3. The Executive Engineer (Civil), PIU, Bankura, WBDWSIP, PHE Dte.
4. The Executive Engineer (M/E), PIU, Bankura, WBDWSIP, PHE Dte.
5. The Sub-Divisional Officer, Bankura Sadar Sub-Division, PHE Dte.
6. The Sub-Divisional Officer, Khatra Sub-Division, PHE Dte
7. The Assistant Engineer-I/(HQ), PIU, Bankura, WBDWSIP, PHE Dte.
8. The BDO, Indpur Block, Bankura
9. The BDO, Taldangra Block, Bankura
10. The BDO, Mejhia Block, Bankura
11. The BDO, Gangajalghati, Bankura
- 12 - 42. The Pradhan, GP, Block, Bankura
- 43-71. The Member, GP, Block, Bankura
72. The Team Leader, DSISC-Bankura, PIU, Bankura, WBDWSIP, PHE Dte.
73. The Support Staff, Environment safeguard, DSISC-Bankura, PIU, Bankura, WBDWSIP, PHE Dte.
74. The Support Staff, Social safeguard, DSISC-Bankura, PIU, Bankura, WBDWSIP, PHE Dte
75. The Project Manager, Package- BK 01, TE-SNE JV
76. The Project Manager, Package- BK 02A, L&T Limited
77. The Project Manager, Package- BK 02B, L&T Limited
78. The Project Manager, Package- BK 03, L&T Limited
79. The Project Manager, Package- BK 04, L&T Limited
80. The Project Health and Safety Officer, Package- BK 01, TE-SNE JV,
81. The Project Health and Safety Officer, Package- BK 02A, L&T Limited
82. The Project Health and Safety Officer, Package- BK 02B, L&T Limited
83. The Project Health and Safety Officer, Package- BK 03, L&T Limited
84. The Project Health and Safety Officer, Package- BK 04, L&T Limited

S. Sami 24/10/19
Superintending Engineer
PIU, Bankura, WBDWSIP, PHE Dte.

Environment & Social Safeguard Unit- Bankura



Memo No. PMU/WBDWSIP/PHED/94/355

Dated : 01-04-2024

OFFICE ORDER

Public Health Engineering Department (PHED) has established a dedicated "Environment and Social Safeguard Unit (ESSU)" at Project Implementation Unit (PIU) level, Bankura to ensure the implementation of Environmental and Social Safeguards as per ADB's Safeguard Policy Statement (SPS), 2009 and requisite requirements under Loan No. 3696-IND.

Environment, Social and GESI- PIU, Bankura

	Designation	Name	Contact details	Status
1	Executive Engineer, PIU Bankura	Mr Pritwish Bhattacharya	+91-9330851223	Available since- September 2022
2	Assistant Engineer-I, PIU Bankura	Mr. Srinjay Das	+91-9007398555	Available since- Feb 2024
3	Team Leader, DSISC, Bankura	Mr. Arvind Kumar Pandeya	+91-7631900046	Available since- December 2023
4	Social, Gender and Resettlement Specialist, DSISC, Bankura	Mr. Hasanul Islam	+91-6051841215	Available since- December 2019
5	Environmental Specialist, DSISC, Bankura			

AYESHA RANI A, IAS
Sr. Special Secretary, PHED and
Project Director, PMU, WBDWSIP

Memo No. PMU/WBDWSIP/PHED/94/355

Dated : 01-04-2024

Copy forwarded for information to :

- 1) Superintending Engineer, PIU, WBDWSIP, PHED

AYESHA RANI A, IAS
Sr. Special Secretary, PHED and
Project Director, PMU, WBDWSIP

PURBA MEDINIPUR

PIU Level GRC- Purba Medinipur

Government of West Bengal
Office of The Superintending Engineer
Project Implementation Unit, Purba Medinipur
W.B. Drinking Water Sector Improvement Project
Public Health Engineering Directorate



Address:
Bar Padumbasan
(Old Zilla Parishad Office Building)
Maniktala, Tamluk, Purba Medinipur, 721636
Email : piu.pm.adb@gmail.com ;
se.piupurmed.adb@wbphed.gov.in
Phone – (03228) 266250

Memo No: 238 / SE / PIU / PM

Dated Tamluk the, 12 / 12 / 2019

NOTIFICATION

In order to address Social, Environmental and any other project or sub project related grievances in the implementation of Asian Development Bank (ADB) assisted Piped Water Supply Scheme in the district of Purba Medinipur under West Bengal Drinking Water Sector Improvement Project (WBDWSIP), a project level Grievance Redress Mechanism has been developed at PIU Level for PIU, Purba Medinipur, WBDWSIP, PHE Dte. with the following members:

1. **Chairperson** – The Executive Engineer (Civil), PIU, PM, WBDWSIP, PHE Dte.
2. **Member** - The Executive Engineer-I (M/E), PIU, PM, WBDWSIP, PHE Dte.
3. **Assistant Safeguard & Gender Officer** – The Assistant Engineer-II, PIU, PM, WBDWSIP, PHE Dte.
4. **Assistant Environmental Officer** – The Assistant Engineer-I, PIU, PM, WBDWSIP, PHE Dte.
5. **Junior Safeguard & Gender Officer** – The Junior Engineer-I, PIU, PM, WBDWSIP, PHE Dte.
6. **Junior Environmental Officer** – The Junior Engineer-I, PIU, PM, WBDWSIP, PHE Dte.
7. **Social/Gender/Resettlement Specialist** – DSISC, Purba Medinipur

The function of GRC at PIU level are as follows: -

- i. Accept Grievances of the Aggrieved persons through grievance redress/suggestion forms in complaints/suggestions boxes or through telephonic hotlines at accessible locations, by e-mail, by post or by writing in a complaint register in PIU office.
- ii. Careful documentation of the name of the complainer, date of receipt of the complaint, address/contact details of the aggrieved person, location of the problem area etc.
- iii. Address and facilitate resolution of Grievances not resolved at the field level within stipulated time (7 days)
- iv. The Assistant Safeguard Officer, PIU, Purba Medinipur, supported by the Social safeguard specialist of DSISC. PIU, Purba Medinipur will be responsible for conducting meeting with the affected/aggrieved person (s) to understand their concerns and help them through the process or grievances of non-literate affected persons and explaining the process of grievance redress mechanism.
- v. If the If the PIU level GRC fails to resolve the Grievance, the matter may be conveyed to the GRC established within PMU and the actions suggested by them to taken up/ followed by this GRC.
- vi. PMU HSGO together with PIU safeguard officer will have the join responsibility for timely Grievance Redress on safeguards and Gender Issues and for registration of Grievance related disclosure and communication with the aggrieved party.
- vii. If Grievance cannot be resolved at the Project Level, they be refereed to the District Steering Committee (DSC) which will also act as Grievance Redressal Committee, particularly in matter related to Land Purchase and or acquisition, payment of the compensation and environmental pollution among others.

- viii. Any matter deemed higher than the district level or that may require inter-departmental coordination, the require Grievance redress will be referred to the State Level Steering Committee.
- ix. The GRC at PIU, Purba Medinipur will also responsible for follow-through for each grievance periodic information dissemination to complaints on the status of their grievances and recording their feedback (satisfaction/dissatisfaction and suggestions)
- x. Periodically Review the functioning of the GRM at this end as well as level.
The GRC will continue to function throughout the project duration.




Superintending Engineer
PIU, PM, WBDWSIP, PHE Dte.

Memo No: 238 / 1 - 9 / SE / PIU / PM

Dated Tamruk the. 12 / 12 / 2019

Copy forwarded for information and necessary action to:-

- i) The Chief Engineer & Project Director, PMU, WBDWSIP, PHE Dte.
- ii) The Superintending Engineer (M/E), PMU, WBDWSIP, PHE Dte.
- iii) The Executive Engineer-I, PMU, WBDWSIP, PHE Dte.
- iv) The Executive Engineer, PIU, PM, WBDWSIP, PHE Dte.
- v) The Executive Engineer-I (M/E), PIU, PM, WBDWSIP, PHE Dte.
- vi) The Assistant Engineer-I, PIU, PM, WBDWSIP, PHE Dte.
- vii) The Assistant Engineer-II, PIU, PM, WBDWSIP, PHE Dte.
- viii) The Junior Engineer-I, PIU, PM WBDWSIP, PHE Dte.
- ix) The Deputy Team Leader, DSISC, Purba Medinipur



Superintending Engineer
PIU, PM, WBDWSIP, PHE Dte.

Field Level GRC

Government of West Bengal
Office of The Superintending Engineer
Project Implementation Unit, Purba Medinipur
W.B. Drinking Water Sector Improvement Project
Public Health Engineering Directorate



Address:
Bar Padumbasan
(Old Zilla Parishad Office Building)
Maniktala, Tamruk, Purba Medinipur, 721636
Email : piu.pm.adb@gmail.com ;
se.piupurmed.adb@wbphed.gov.in
Phone – (03228) 266250

Memo No: 67 / SE / PIU / PM

Dated Tamruk the, 13 / 02 / 2020

NOTIFICATION

In order to address Social, Environmental and any other project or subproject related grievances during implementation of Asian Development Bank (ADB) assisted piped water supply scheme in the district of East Medinipur (selected four Blocks Nandigram-I, Nandigram-II, Chandipur- and Nandakumar) under West Bengal Drinking Water Sector Improvement Project (WBDWSIP), a **field level Grievance Redress Mechanism** has been developed for different packages under this project with the following members.

1. Assistant Safeguard & Gender Officer (The Assistant Engineer-II, PIU, PM, WBDWSIP, PHE Dte.) – **Chairperson**
2. Assistant Environment Officer (The Assistant Engineer-I, PIU, PM, WBDWSIP, PHE Dte.) – **Member**
3. Junior Safeguard & Gender Officer (The Junior Engineer-I, PIU, PM, WBDWSIP, PHE Dte) – **Member**
4. Junior Environment Officer (The Junior Engineer-I, PIU, PM, WBDWSIP, PHE Dte) – **Member**
5. Gram-Panchayat Pradhan of the concerned G.P. – **Member**
6. Panchayat Member of the concerned G.P. (Preferably Women) – **Member**
7. Social/Gender and Resettlement Specialist (DSISC) – **Member**
8. Support Staff Social (DSISC) – **Member**
9. Support Staff Environment (DSISC) – **Member**
10. Team Leader/representative of the Project NGO (East Medinipur) – **Member**
11. Health and Safety Officer from respective Project Contractor's representative – **Member**

*Mr. Anisban
for information
and necessary
action.
Jellu
19/2/20*

The function of the field level grievance redress committee (GRC) to address field level grievances are as follows:

- I. Accept grievances of the aggrieved person/s through grievance redress / suggestions forms in complaints / suggestion boxes or through telephonic hotlines at accessible locations, by e-mail, by post or by writing in complaint register in PIU office / field office of contractor.
- II. Careful documentation of the name of the complainant, date of receipt, address / contact details of the aggrieved person/s, location of the problem area and nature of the problem etc.
- III. Address and facilitate resolution of the Grievance / complaint within the stipulated time (7 days).
- IV. Health and Safety Officer of the Project Contractor supported the Social and Environment Safeguard support staffs from DSISC, PIU east Medinipur will be primarily responsible for conducting meeting/s with the affected / aggrieved person/s to understand their concern/s and help them through the process of grievance redress including translating the complaint/s in Bengali or English, recording and registering grievances of non-literate person/s and explaining the process of grievance redress mechanism.
- V. If the Field Level GRC fails to resolve the grievance/s, the matter may be conveyed to the PIU level GRC and the actions suggested may be followed by the field level GRC.
- VI. Field Level GRC will have the primary responsibility for timely grievance redress on safeguard and gender issues and for registration/recording of grievances, related disclosure and communication with the aggrieved party.

- VII. Field level GRC will be responsible for follow-up of each grievance, periodic information dissemination to complainants about the status of their grievance/s and recording their feedback (satisfaction/dissatisfaction and suggestions).

The GRC will continue throughout the WBDWSIP project duration at concerned Block / Gram Panchayats.

13.2.2020
Superintending Engineer
PIU, PM, WBDWSIP, PHE Dte.

Memo No: 67 / 1 - 60 / SE / PIU / PM

Dated Tamruk the, 13 / 02/ 2020

Copy forwarded for information and necessary action to:-

1. The Chief Engineer & Project Director, PMU, WBDWSIP, PHE Dte.
2. The Superintending Engineer, PMU, WBDWSIP, PHE Dte.
3. The Superintending Engineer (M/E), PMU, WBDWSIP, PHE Dte.
4. The Executive Engineer-I, PMU, WBDWSIP, PHE Dte.
5. The Executive Engineer, PIU, PM, WBDWSIP, PHE Dte.
6. The Executive Engineer-I (M/E), PIU, PM, WBDWSIP, PHE Dte.
7. The Assistant Engineer-I, PIU, PM, WBDWSIP, PHE Dte.
8. The Assistant Engineer-II, PIU, PM, WBDWSIP, PHE Dte.
- 9-12. The Sabhapati, Nandigram-I, Nandigram-II, Chandipur, Nandakumar Panchayat Samity
- 13-16. The Block Development Officer, Nandigram-I, Nandigram-II, Chandipur, Nandakumar Block.
17. The Junior Engineer-I, PIU, PM WBDWSIP, PHE Dte.
- 18-56. The Pradhan,GP, Nandigram - I / Nandigram-II/Nandakumar/Chandipur Panchayat Samity, Purba Medinipur.
57. The Deputy Team Leader, DSISC, Purba Medinipur
58. The Chief Operative Officer, Project NGO for WBDWSIP, Purba Medinipur
59. The Project Manager-EM01, Larsen & Toubro Limited.
60. The Project Manager, EM02, Larsen & Toubro Limited.

13.2.2020
Superintending Engineer
PIU, PM, WBDWSIP, PHE Dte.

Environment & Social Safeguard Unit- East Medinipur



Memo No. PMU/WBDWSIP/PHED/94 /357

Dated : 01-04-2024

OFFICE ORDER

Public Health Engineering Department (PHED) has established a dedicated Environment and Social Safeguard Unit (ESSU) at project Implementation Unit (PIU) level, Purba Medinipur to ensure the implementation of Environmental and Social Safeguards as per ADB's Safeguard Policy Statement (SPS), 2009 and requisite requirements under Loan No.3696-IND.

Environment, Social and GESI- PIU,Purba Medinipur.

	Designation	Name	Contact details	Status
1	Executive Engineer, PIU,Purba Medinipur.	Mr.Chinmoy Raha	+91-9475608904	Available since- Jan 2024
2	Assistant Engineer-I PIU,Purba Medinipur.	Dr. Tapash Bera	+91-8597245053	Available since- August 2018.
3	Team Leader DSISC,Purba Medinipur	Mr.Abbubakar Molla	+91-7869924214	Available since- February2021
4	Social, Gender & Resettlement Specialist,DSIS,Purba Medinipur	Mr. Anirban Chattopadhyay	+91-8334942333	No mobilization more than 1year
5	Environmental Specialist, DSISC Purba Medinipur.	Mr.Partho Serathi Mukherjee	+91-7003681499	No mobilization more than 1year



AYESHA RANI A, IAS
Sr. Special Secretary, PHED and
Project Director, PMU, WBDWSIP

Memo No. PMU/WBDWSIP/PHED/94/357

Dated : 01-04-2024

Copy forwarded for information to

- 1) Superintending Engineer,(Civil),PIU,WBDWSIP,PHED


AYESHA RANI A, IAS
Sr. Special Secretary, PHED and
Project Director, PMU, WBDWSIP

APPENDIX 7: CONSULTATION AT FIELD LEVEL

NORTH 24 PGS

Report of the Site Visit and Consultation- SAMPLE
Conducted by the DSISC Team along with the Contractor's Team.
Date: 15th April, 2024
Bhangar-II, zone-03

Persons presents:

Sl.	Name	Designation	Contact Number
1	Noor Islam Sk	Labor	6297522899
2	Jalal Sardar	Labor	6297820040
3	Rahmaan Sk	Labour	6296579069
4	Babu Sardar	Labour	-
6	Balaram Sardar	Supervisor of Sub Contractor	9046463307
7.	Faruq Molla	Villager	-
10.	Rohan Kumar	Support Staff, Environment Safeguard, DSISC	9330496255
11.	Dilip Kumar Roy	Support Staff, Social Safeguard, DSISC	9933996977
12.	Srabani Sengupta	Social, Gender & Resettlement Specialist, DSISC	9836022781
13.	Swarnabha Bandyopadhyay	Environment Safeguard Specialist, DSISC	8017668861

The safeguard team conducted a joint site visit cum consultation in Bhangar zone 3 near OHR location along with the contractor's team to understand the environmental and social risks associated with heat waves and site housekeeping cum hygiene.

Heat waves rising in the west Bengal region as well as in major part of Indian continent, which accounts for loss of life in certain cases. Some villagers along with the labourers of site were consulted and educated about heat wave, also preparation activity for site housekeeping and hygiene were investigated and suggestion has been made for improvement.

Heat wave, site management, sanitation and hygiene like important points were discussed as per following details: -

Impacts	Consultation type	Consultation Details
Health and Safety, Housekeeping and Hygiene	Focused Group Discussion	To educate about heat waves, site management and housekeeping with hygiene following issues was discussed: - a) Avoid working during mid-day (12PM to 2PM) when the temperature is too hot for the day i.e. hot time, b) Scheduling of work required in morning from 6 AM to 11 AM and in evening 3 PM to 6 PM. c) Keep hydrated with water, Lemon drink, Glucon D recommended solution. d) Must take rest near shade if feel unconvertable and inform authority for medical emergency. e) Practice good working habit to maintain hygiene in the worksite f) Storing of water in covered pot and placement in cool place should be maintained at site. g) Washing the hands with soap and water strongly

		<p>recommended before taking food</p> <ul style="list-style-type: none">h) Sanitation structure such as toilet should be made as prescribed in Swachh Bharat Adhyayan Guideline to maintain water free from any pollutants.i) Clean and sufficient water for drinking, bathing and sanitation needs attention at sitej) Electrical connection and boards must be updated to ensure safe working environment at site.k) Kitchen facility must be built separately to avoid fire and to maintain good housekeeping in campl) Camp shed must be replaced with non-combustible materials such as metal/cemented sheet to avoid fire hazards.
--	--	--

Photographs:



Contract Package-WBDWSIP/DWW/NCB/N24P/01/2017: WTP-Pipeline

Public Consultation during construction (weekly for different working sites) - WBDWSIP

Package- (01) - Pipeline
Area- 1200 mm dia MS Pipeline work.

Sr. No.	Road/Lane No.	Date	PHE and utility service Connection Restoration- (In case affected) Remarks	Overburden soil / sludge/ silt removal -Remarks	Road Restoration- Remarks	Dust and noise problem-Remarks	Social safety arrangement- Caution tape/ barricade etc. by contractor - Remarks	Problem of local movements due to project activity - Remarks	Other Problem faced if any	Name of the person with address/ contact No.	Signature
1	Street No. 77	26/09/24	Partial Seen	NIL	Partial Seen	NIL	Partial Seen	NIL	NIL	Mohan Saha	[Signature]
2	Street No. 77	26/09/24	''	NIL	''	NIL	''	NIL	NIL	Jatan Das	[Signature]

Note: At least 8 such consultation in a month

Need clear view from locals

(Done By DS/SE)

Rohan Kumar

(Date & Signature of Safety officer/ Engineer of Contractor)

Contract Package-WBDWSIP/DWW/NCB/N24P/02B/2017: Bhangar II Block

Public Consultation during construction (weekly for different working sites) - WBDWSIP

Package- 02(B)
Area- (09)-OTR, site

Sr. No.	Road/Lane No.	Date	PHE and utility service Connection Restoration- (in case affected) Remarks	Overburden soil / sludge/ silt removal -Remarks	Road Restoration- Remarks	Dust and noise problem- Remarks	Social safety arrangement- Caution tape/ barricade etc. by contractor - Remarks	Problem of local movements due to project activity - Remarks	Other Problem faced if any	Name of the person with address/ contact No.	Signature
1		29/03/24	NIL	NIL	NIL	Footfall sound	NIL	NIL	NIL	Navita Mondol	निविता मंडल
2		29/03/24	NIL	NIL	NIL))	NIL	NIL	NIL	Uptav Bishwas	उपताव बिश्वास

Note: At least 8 such consultation in a month

Need clear view from locals

(Done by PSE)

Rohan Kumar

(Date & Signature of Safety officer/ Engineer of Contractor)

Photographs of Public Consultation



Package-01



Package-02B

BANKURA

Sample Field level consultation

No consultation conducted for package BKP/01 during the reporting period as the pipeline work stopped and construction at Intake and WTP are site specific, do not require any interaction with public.

Package- WBDWSIP/DWW/NCB/ BK/02A/2018-19

Sample copy

Public Consultation during construction (weekly for different working sites) - WBDWSIP

Package <i>Bankura - Jajpur</i>											
Area <i>Jajpur</i>											
Sr. No.	Road Lane No.	Date	PHE and utility service Connection Restoration- (in case affected) Remarks	Overburden soil / sludge/ silt removal- Remarks	Road Restoration- Remarks	Dust and noise problem- Remarks	Social safety arrangement- Caution tape, barricade etc. by contractor - Remarks	Problem of local movements due to project activity- Remarks	Other Problem faced if any	Name of the person with address/ contact No.	Signature
1.	<i>Chakra</i>	<i>21/11/23</i>	<i>OK</i>	<i>OK</i>	<i>OK</i>	<i>OK</i>	<i>OK</i>	<i>NO</i>	<i>NO</i>	<i>Bhola Mohan</i> <i>9921017102</i>	<i>[Signature]</i>
2.	<i>Chakra</i>	<i>21/11/23</i>	<i>OK</i>	<i>OK</i>	<i>OK</i>	<i>OK</i>	<i>OK</i>	<i>NO</i>	<i>NO</i>	<i>Shankar Singh</i> <i>9921017102</i>	<i>[Signature]</i>
3.	<i>Chakra</i>	<i>21/11/23</i>	<i>OK</i>	<i>OK</i>	<i>OK</i>	<i>OK</i>	<i>OK</i>	<i>NO</i>	<i>NO</i>	<i>Bhola Mohan</i> <i>9921017102</i>	<i>[Signature]</i>
4.	<i>Chakra</i>	<i>21/11/23</i>	<i>OK</i>	<i>OK</i>	<i>OK</i>	<i>OK</i>	<i>OK</i>	<i>NO</i>	<i>NO</i>	<i>Sandip Kumar</i> <i>9921017102</i>	<i>[Signature]</i>

Package- WBDWSIP/DWW/NCB/ BK/02B/2018-19
Sample copy

Public Consultation during construction (weekly for different working sites) - WBDWSIP

Package- WBDWSIP/DWW/NCB/ BK/02B/2018-19

Area - *WBDWSIP*

Sr. No.	Road Lane No.	Date	PNE and utility services Connection/Restoration (In case affected) Remarks	Overburden soil / dredge/ all removal -Remarks	Road Restoration-Remarks	Dust and noise problem-Remarks	Social safety arrangement/ Caution tape/ barricade etc. by contractor -Remarks	Problems of local movements due to project activity-Remarks	Other Problems found if any	Name of the person with address contact No.	Signature
1	<i>WBDWSIP</i>	<i>11/11/2023</i>	<i>0</i>	<i>0</i>	<i>0</i>	<i>0</i>	<i>0</i>	<i>0</i>	<i>0</i>	<i>WBDWSIP</i>	<i>WBDWSIP</i>

Package- WBDWSIP/DWW/NCB/ BK/03/2018-19

No consultation conducted during the reporting period as the pipeline work stopped and construction at Intake and WTP are site specific, do not require any interaction with public.

Package- WBDWSIP/DWW/NCB/BK/04/2018-19

Sample copy

Public Consultation during construction (weekly for different working sites) - WBDWSIP

Package- WBDWSIP/DWW/NCB/BK/04/2018-19

Area - *WBDWSIP*

Sr. No.	Road Lane No.	Date	PNE and utility services Connection/Restoration (In case affected) Remarks	Overburden soil / dredge/ all removal -Remarks	Road Restoration-Remarks	Dust and noise problem-Remarks	Social safety arrangement/ Caution tape/ barricade etc. by contractor -Remarks	Problems of local movements due to project activity-Remarks	Other Problems found if any	Name of the person with address contact No.	Signature
1	<i>WBDWSIP</i>	<i>11/11/2023</i>	<i>0</i>	<i>0</i>	<i>0</i>	<i>0</i>	<i>0</i>	<i>0</i>	<i>0</i>	<i>WBDWSIP</i>	<i>WBDWSIP</i>
2	<i>WBDWSIP</i>	<i>11/11/2023</i>	<i>0</i>	<i>0</i>	<i>0</i>	<i>0</i>	<i>0</i>	<i>0</i>	<i>0</i>	<i>WBDWSIP</i>	<i>WBDWSIP</i>
3	<i>WBDWSIP</i>	<i>11/11/2023</i>	<i>0</i>	<i>0</i>	<i>0</i>	<i>0</i>	<i>0</i>	<i>0</i>	<i>0</i>	<i>WBDWSIP</i>	<i>WBDWSIP</i>
4	<i>WBDWSIP</i>	<i>11/11/2023</i>	<i>0</i>	<i>0</i>	<i>0</i>	<i>0</i>	<i>0</i>	<i>0</i>	<i>0</i>	<i>WBDWSIP</i>	<i>WBDWSIP</i>
5	<i>WBDWSIP</i>	<i>11/11/2023</i>	<i>0</i>	<i>0</i>	<i>0</i>	<i>0</i>	<i>0</i>	<i>0</i>	<i>0</i>	<i>WBDWSIP</i>	<i>WBDWSIP</i>
6	<i>WBDWSIP</i>	<i>11/11/2023</i>	<i>0</i>	<i>0</i>	<i>0</i>	<i>0</i>	<i>0</i>	<i>0</i>	<i>0</i>	<i>WBDWSIP</i>	<i>WBDWSIP</i>

Note: At least 15 min consultation in a month

Read clear view from locals

[Signature]
Date & Signature of Safety officer/ Engineer in Charge

Public consultation photographs



PKG- BK/2B



PKG- BK/02B



PKG BK/04

EAST MEDINIPUR

Package: EM/01

Public Consultation during construction (weekly for different working sites) - WBDWSIP

Package- EM 02 (Medinipur DWSP) / 67401 / Medinipur Tutrice & IOTP

SL. No.	Road/Lane No.	Date	PHE and utility service Connection Restoration- (in case affected) Remarks	Overburden soil / sludge/ silt removal - Remarks	Road Restoration- Remarks	Dust and noise problem- Remarks	Social safety arrangement- Caution tape/ barricade etc. by contractor - Remarks	Problem of local movements due to project activity - Remarks	Other Problem faced if any	Name of the person with address/ contact No.	Signature
1	Tutrice	09/1/24	✓	-	-	-	-	-	-	Mr Jordan	[Signature]
2	Chaulpara	10/1/24	✓	-	-	-	-	-	-	Mr Babu Kumar	[Signature]
3	Dasara	12/1/24	✓	✓	-	-	-	-	-	Mr Subrata	[Signature]
4	Kanarpur	21/1/24	-	-	-	✓	-	-	-	Mr Jordan	[Signature]

Note: At least 8 such consultation in a month
Need clear view from locals

(Date & Signature of Safety officer/ Engineer of Contractor)

Sanjiv LMT Construction Internal Site

[Signature: Praveen Jaiswal]

LMT

Package: EM/02

Public Consultation during construction (weekly for different working sites) - WBDWSIP

Package- EM 02 (Medinipur DWSP)

SL. No.	Road/Lane No.	Date	PHE and utility service Connection Restoration- (in case affected) Remarks	Overburden soil / sludge/ silt removal - Remarks	Road Restoration- Remarks	Dust and noise problem- Remarks	Social safety arrangement- Caution tape/ barricade etc. by contractor - Remarks	Problem of local movements due to project activity - Remarks	Other Problem faced if any	Name of the person with address/ contact No.	Signature
1	JL 100/15	01/01/24	-	-	✓	-	-	-	-	SK. Meher	[Signature]
2	JL 100/13	06/01/24	-	-	-	✓	-	-	-	Riya SK.	[Signature]
3	JL 100/2	07/01/24	-	-	-	✓	-	-	-	Mr. Gulam	[Signature]
4	JL 100/2	12/01/24	-	-	-	✓	-	-	-	Prasanta Bhowmik	[Signature]
5	JL 100/55	17/01/24	-	-	✓	-	-	-	-	Soufal Kumar	[Signature]
6	JL 100/60	19/01/24	-	-	✓	-	-	-	-	Gulam Ali	[Signature]
7	JL 100/12	20/01/24	-	-	✓	-	-	-	-	Mr. Sabir	[Signature]
8	JL 100/12	27/01/24	-	-	-	✓	-	-	-	Raju Mishra	[Signature]

Note: At least 8 such consultation in a month
Need clear view from locals

(Date & Signature of Safety officer/ Engineer of Contractor)

Sanjiv LMT Construction Internal Site

[Signature: Sanjiv]

06/05/24

APPENDIX 9: FOCUS GROUP DISCUSSION – ENVIRONMENT & SOCIAL

NORTH 24 PGS


Sl.	Place	Zone	Block	Date	Remarks
1	Polerhat 1 GP	5	Bhangar-II	26.02.24	Group meeting was held with 50 villagers and with NCC and DSISC staff at Zone-5, Tona village North Gazipur under Polerhat Gram Panchayat of Bhangar II Block for proper pipe laying issue at working site. it was decided to lay 90 dia mm pipe on one side and after completion of pipe laying 2-3 places will be dug to check proper backfilling, if backfilling is not done properly with excavated material outside soil will utilize for proper backfilling and labeling. After discussion and mutual consent Villagers allow contractor to start the work
2	Sonapukur-Sankarpur	9	Haroa	04.03.24	Small group meeting conducted in presence of Junior Engineer, PHED, DSISC and NCC representative. After meeting PIU, DSISC & NCC (contractor) representative visited the continuation of laying of outlet and supply pipelines along the approach road leading to OHR Zone 9 of Haroa block. They meet with villagers and discussed about damage part of the brick road. After discussions with villagers and contractor, the contractor agreed to put some brickbats on the severally damaged part of the brick road. NCC has also agreed to lay pipelines along the pond side along the earthen shoulder area along the brick road.

PURBA MEDINIPUR

Sample

Details of Focus Group Discussion

East Medinipur EM 01



Sl. No	Place	Date	Total no of Participant	Topic discussed	Photograph
1.	Icchapur	06.12.2023	M-10, F-1	<ul style="list-style-type: none"> • Different issues due to pipe laying like water body along the pipe alignment, private land issue, road cutting issues etc. • GRM issue discussed. • Discussion on Compensatory Afforestation • Discussion regarding traffic management • Safety related issues • Pipe laying along the PWD/CC road • Proper back filling after pipe laying 	

2.	Shrikrishnapaur	25.01.2024	M-10, F-1		
3	Shitalpur	24.02.2024	M-13, F-2		

4	Kohdambari	27.02.2024	M-10, F-1		
5	Byabottarhat	21.03.2024	M-10, F-1		

6	Kumararah GP	16.04.2024	M-08, F-2		 <p>Mohammadar, West Bengal, India 22°19'51.8468" N, 87°16'41.1111" E 721832, India Lat: 22.331384° Long: 87.278111° 16/04/24 02:05 PM GMT +05:30</p>
7	Dibakarpur	19.04.2024	M-09, F-2		 <p>Dibakarpur, West Bengal, India 22°19'51.8468" N, 87°16'41.1111" E 721832, India Lat: 22.331384° Long: 87.278111° 19/04/24 03:44 PM GMT +05:30</p>

East Medinipur (EM 02)

Sl. No	Place	Date	Total no of Participant	Topic discussed	Photograph
1.	Gokulnagar GP	10.11.2023	M=11, F=1 Total = 12	<ul style="list-style-type: none"> • Different issues due to pipe laying like water body along the pipe alignment, private land issue, road cutting issues etc. • GRM issue discussed. • Discussion on Compensatory Afforestation • Discussion regarding traffic management • Safety related issues • Pipe laying along the PWD/CC road • Proper back filling after pipe laying 	
2.	Haripur GP	22.11.2023	M=08, F=02 Total = 10		

3	Jambari OHSR site	24.11.2023	M=16, F=01 Total = 17		 <p>GPS Map Camera Jambari, West Bengal, India Jambari Rd, Jambari, West Bengal 721432, India Lat 21.958678° Long 87.937056° 24/11/23 12:51 PM GMT +05:30</p>
4	Nandigram II BDO office	04.12.2023	M=09, F=07 Total = 16		 <p>GPS Map Camera Khodambari, West Bengal, India 2WV5+GJV, Khodambari, West Bengal 721850, India Lat 22.944479° Long 87.908657° 04/12/23 12:43 PM GMT +05:30</p>

5	Nandigram I BDO office	08.02.2024	M=11, F=00 Total = 11		
6	Duragapur	26.04.2024	M=10, F=01 Total = 12		

Attendance Sheet of FGD/Public Consultaion












West Bengal Drinking Water Sector Improvement Project
Attendance Sheet for Public/Stakeholders Consultation Meeting

District: Purba Medinipur Block: Nardakumar
 Village (Venue): Sitalpar Duration of Discussion: 1hr 30 minutes
 Date: 24-02-2024 Time: 04.00 P.M
 No. of Participants: 15 (Male: 13 Female 02)

Sl. No.	Name	Sex	Designation	Signature	Phone Number
1	<u>Enkharish Mena</u>	M	<u>Social worker</u>	<u>[Signature]</u>	<u>9434626081</u>
2	<u>Bidyut K. Adak</u>	M	<u>Gov. Person</u>	<u>[Signature]</u>	<u>7004643548</u>
3	<u>Astan Samanta</u>	M	<u>Resident</u>		<u>9732502707</u>
4	<u>Anupam Maity</u>	M	<u>Resident</u>		
5	<u>Ais Kumar Maity</u>	M	<u>Resident</u>		<u>9793804886</u>
6	<u>Ratan Maity</u>	M	<u>FARMER</u>		
7	<u>Nabanita Ray Santra</u>	F	<u>Member</u>		
8	<u>Pratul Chandra Maity</u>	M	<u>Resident</u>		<u>7584140007</u>
9	<u>Khokantra Barua</u>	M	<u>Resident</u>		<u>9647361419</u>
10	<u>Sanjay Mohol</u>	M	<u>Resident</u>		
11	<u>Ramaj Lal Maity</u>	M	<u>Resident</u>		<u>9732449886</u>
12	<u>Lakshmi Kanta Barua</u>	M	<u>Resident</u>		<u>9635487499</u>
13	<u>Sachinanku Barman</u>	M	<u>Farmar</u>	<u>[Signature]</u>	<u>9732982689</u>
14	<u>Jagadish Barua</u>	M	<u>Member</u>	<u>[Signature]</u>	<u>9593621094</u>
15	<u>Sonajyoti Maity</u>	F	<u>DSISE, Social</u>	<u>[Signature]</u>	<u>7031827214</u>

West Bengal Drinking Water Sector Improvement Project
Attendance Sheet for Public/Stakeholders Consultation Meeting

District: Purba Medinipur Block: Nandakumar
Village (Venue): Shrikrishnaker Duration of Discussion: 30 minutes
Date: 25.01.2024 Time: 12.00 P.M
No. of Participants: 11 (Male: 10 Female 01)

Sl. No.	Name	Sex	Designation	Signature	Phone Number
1.	Slc Hasmat Ali	(M)	Businessman		9800060372
2.	MD Sakir	(M)	Farmer		
3.	Gururada Basa	(M)	Shop owner		6296696901
4.	Haider Ali	(M)	Labour		
5.	Abhijit Patro	(M)	Resident		
6.	Rabindranath Giri	(M)	Shop owner		
7.	Rajib Gayen	(M)	Labour		
8.	Surejit Maity	(M)	Farmer		
9.	Tutul Das	(M)	Resident		
10.	Arghya Kausal Sen	(M)	Env. Safeguard, DSISE		7980414285
11.	Sovajyoti Maity	(F)	Social Support Stabb, DSISE		7031827214
12.					
13.					
14.					
15.					